
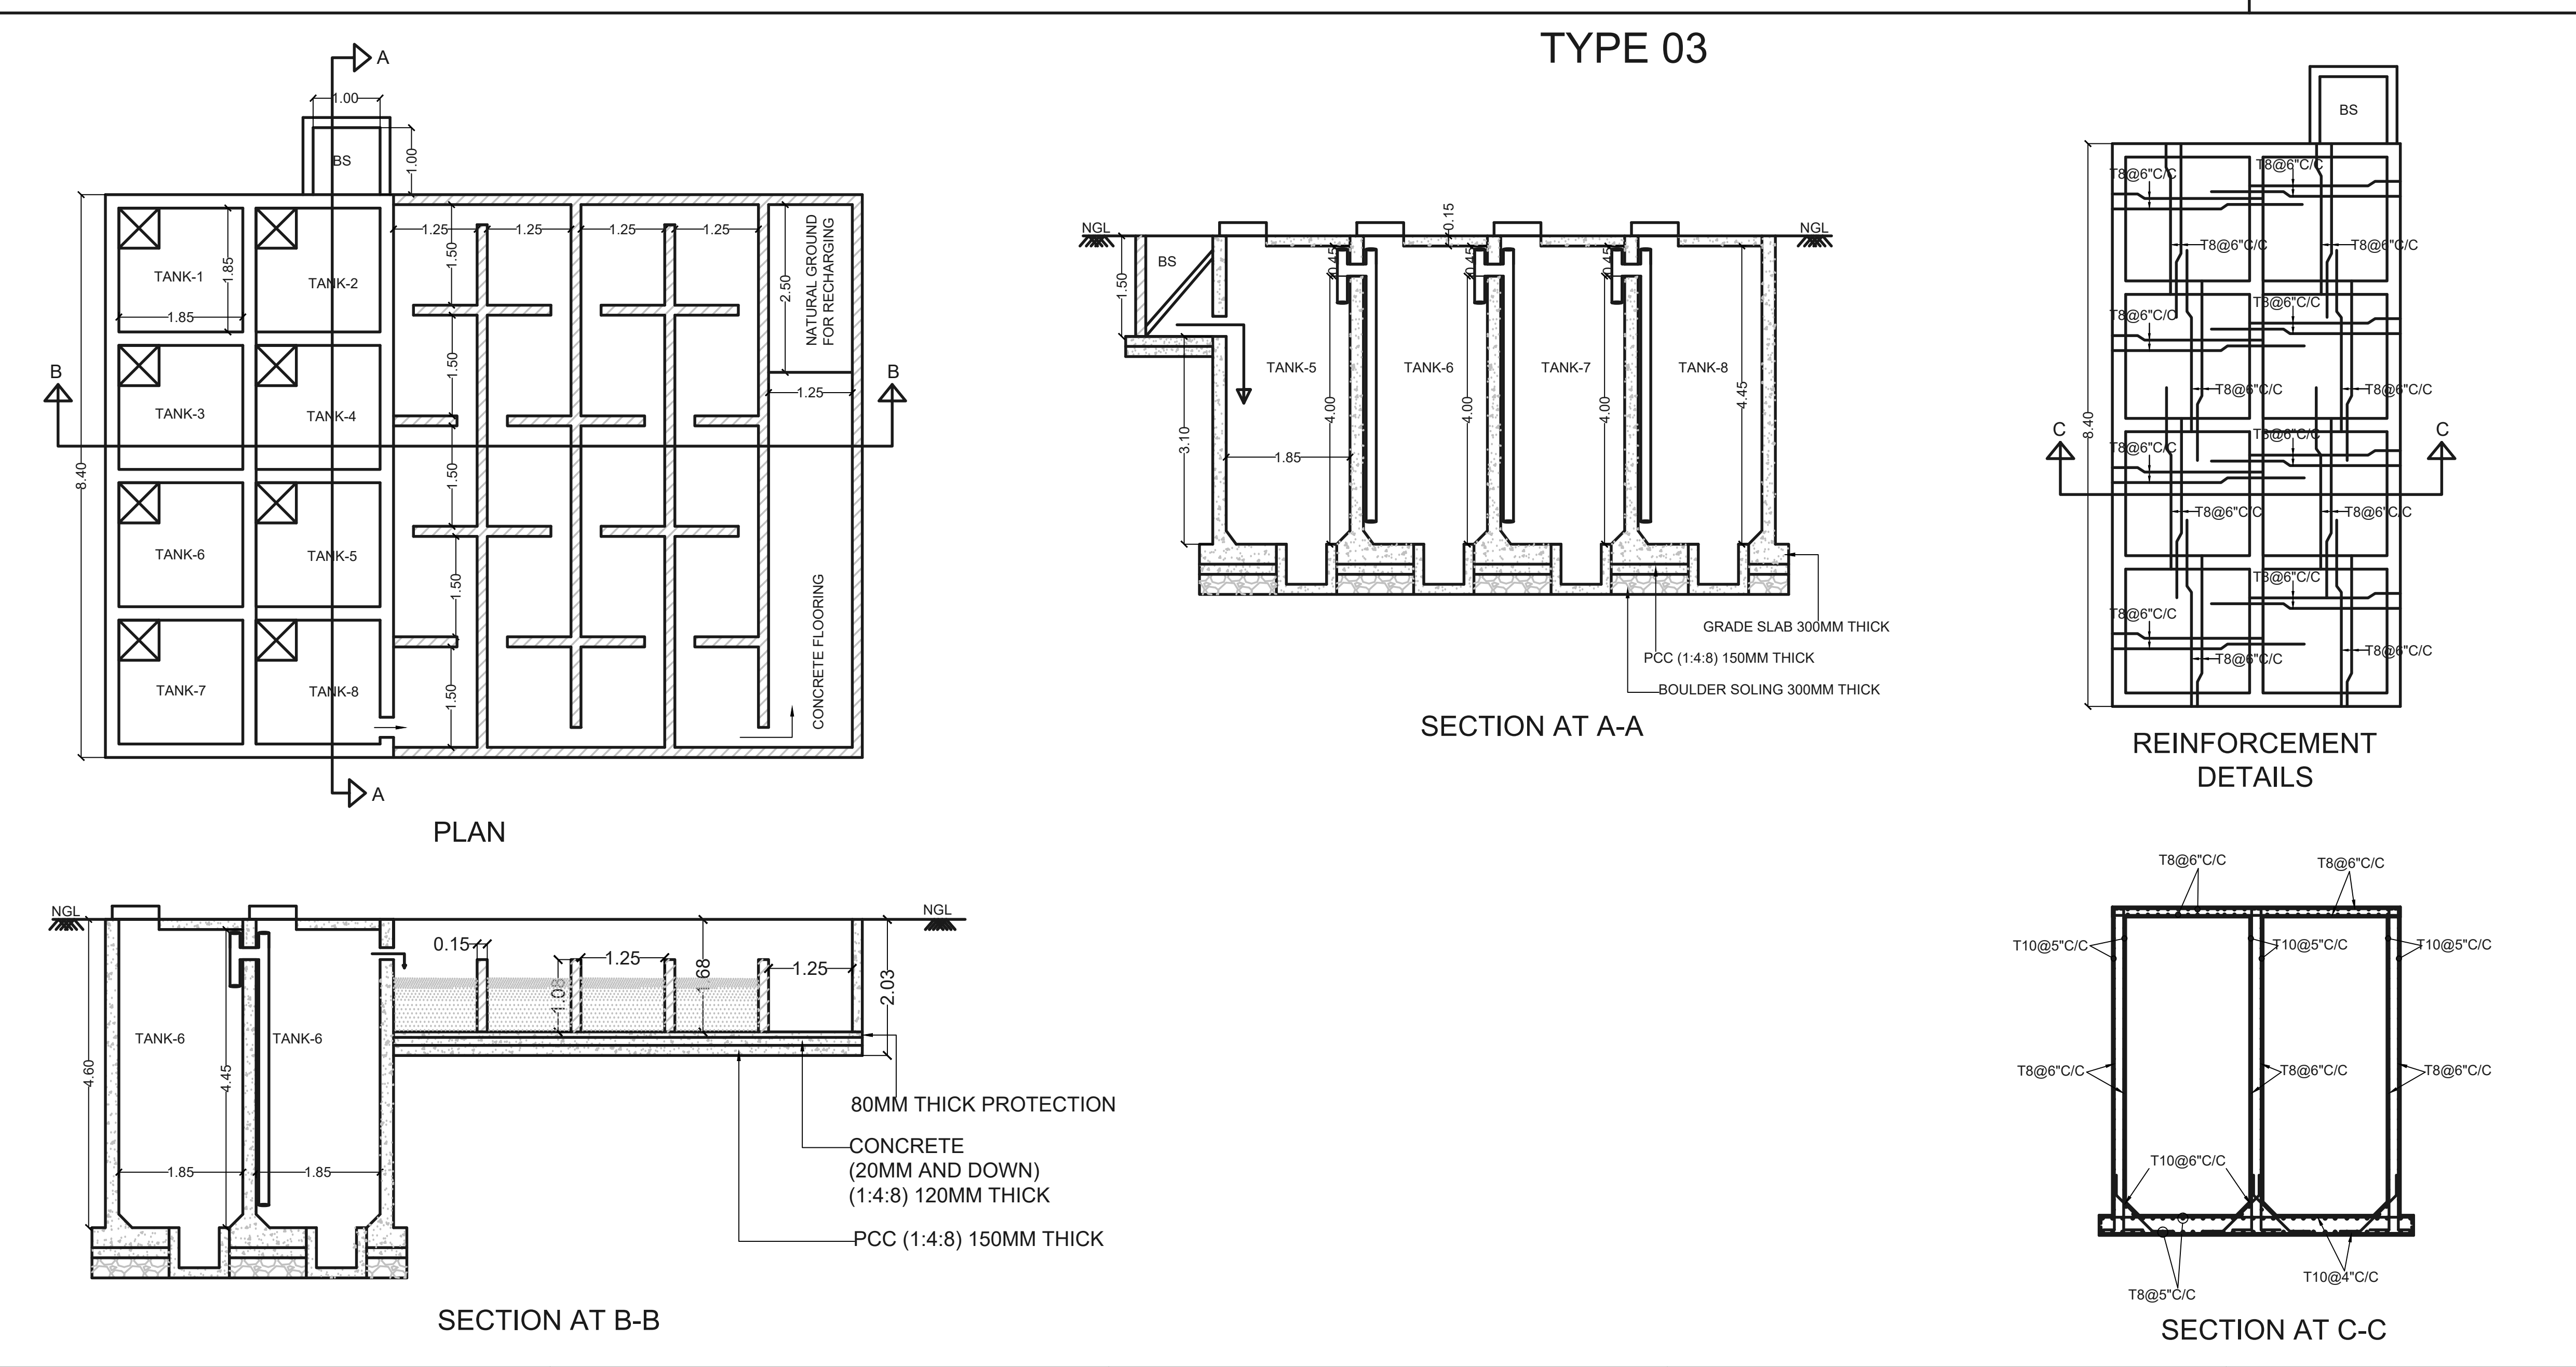
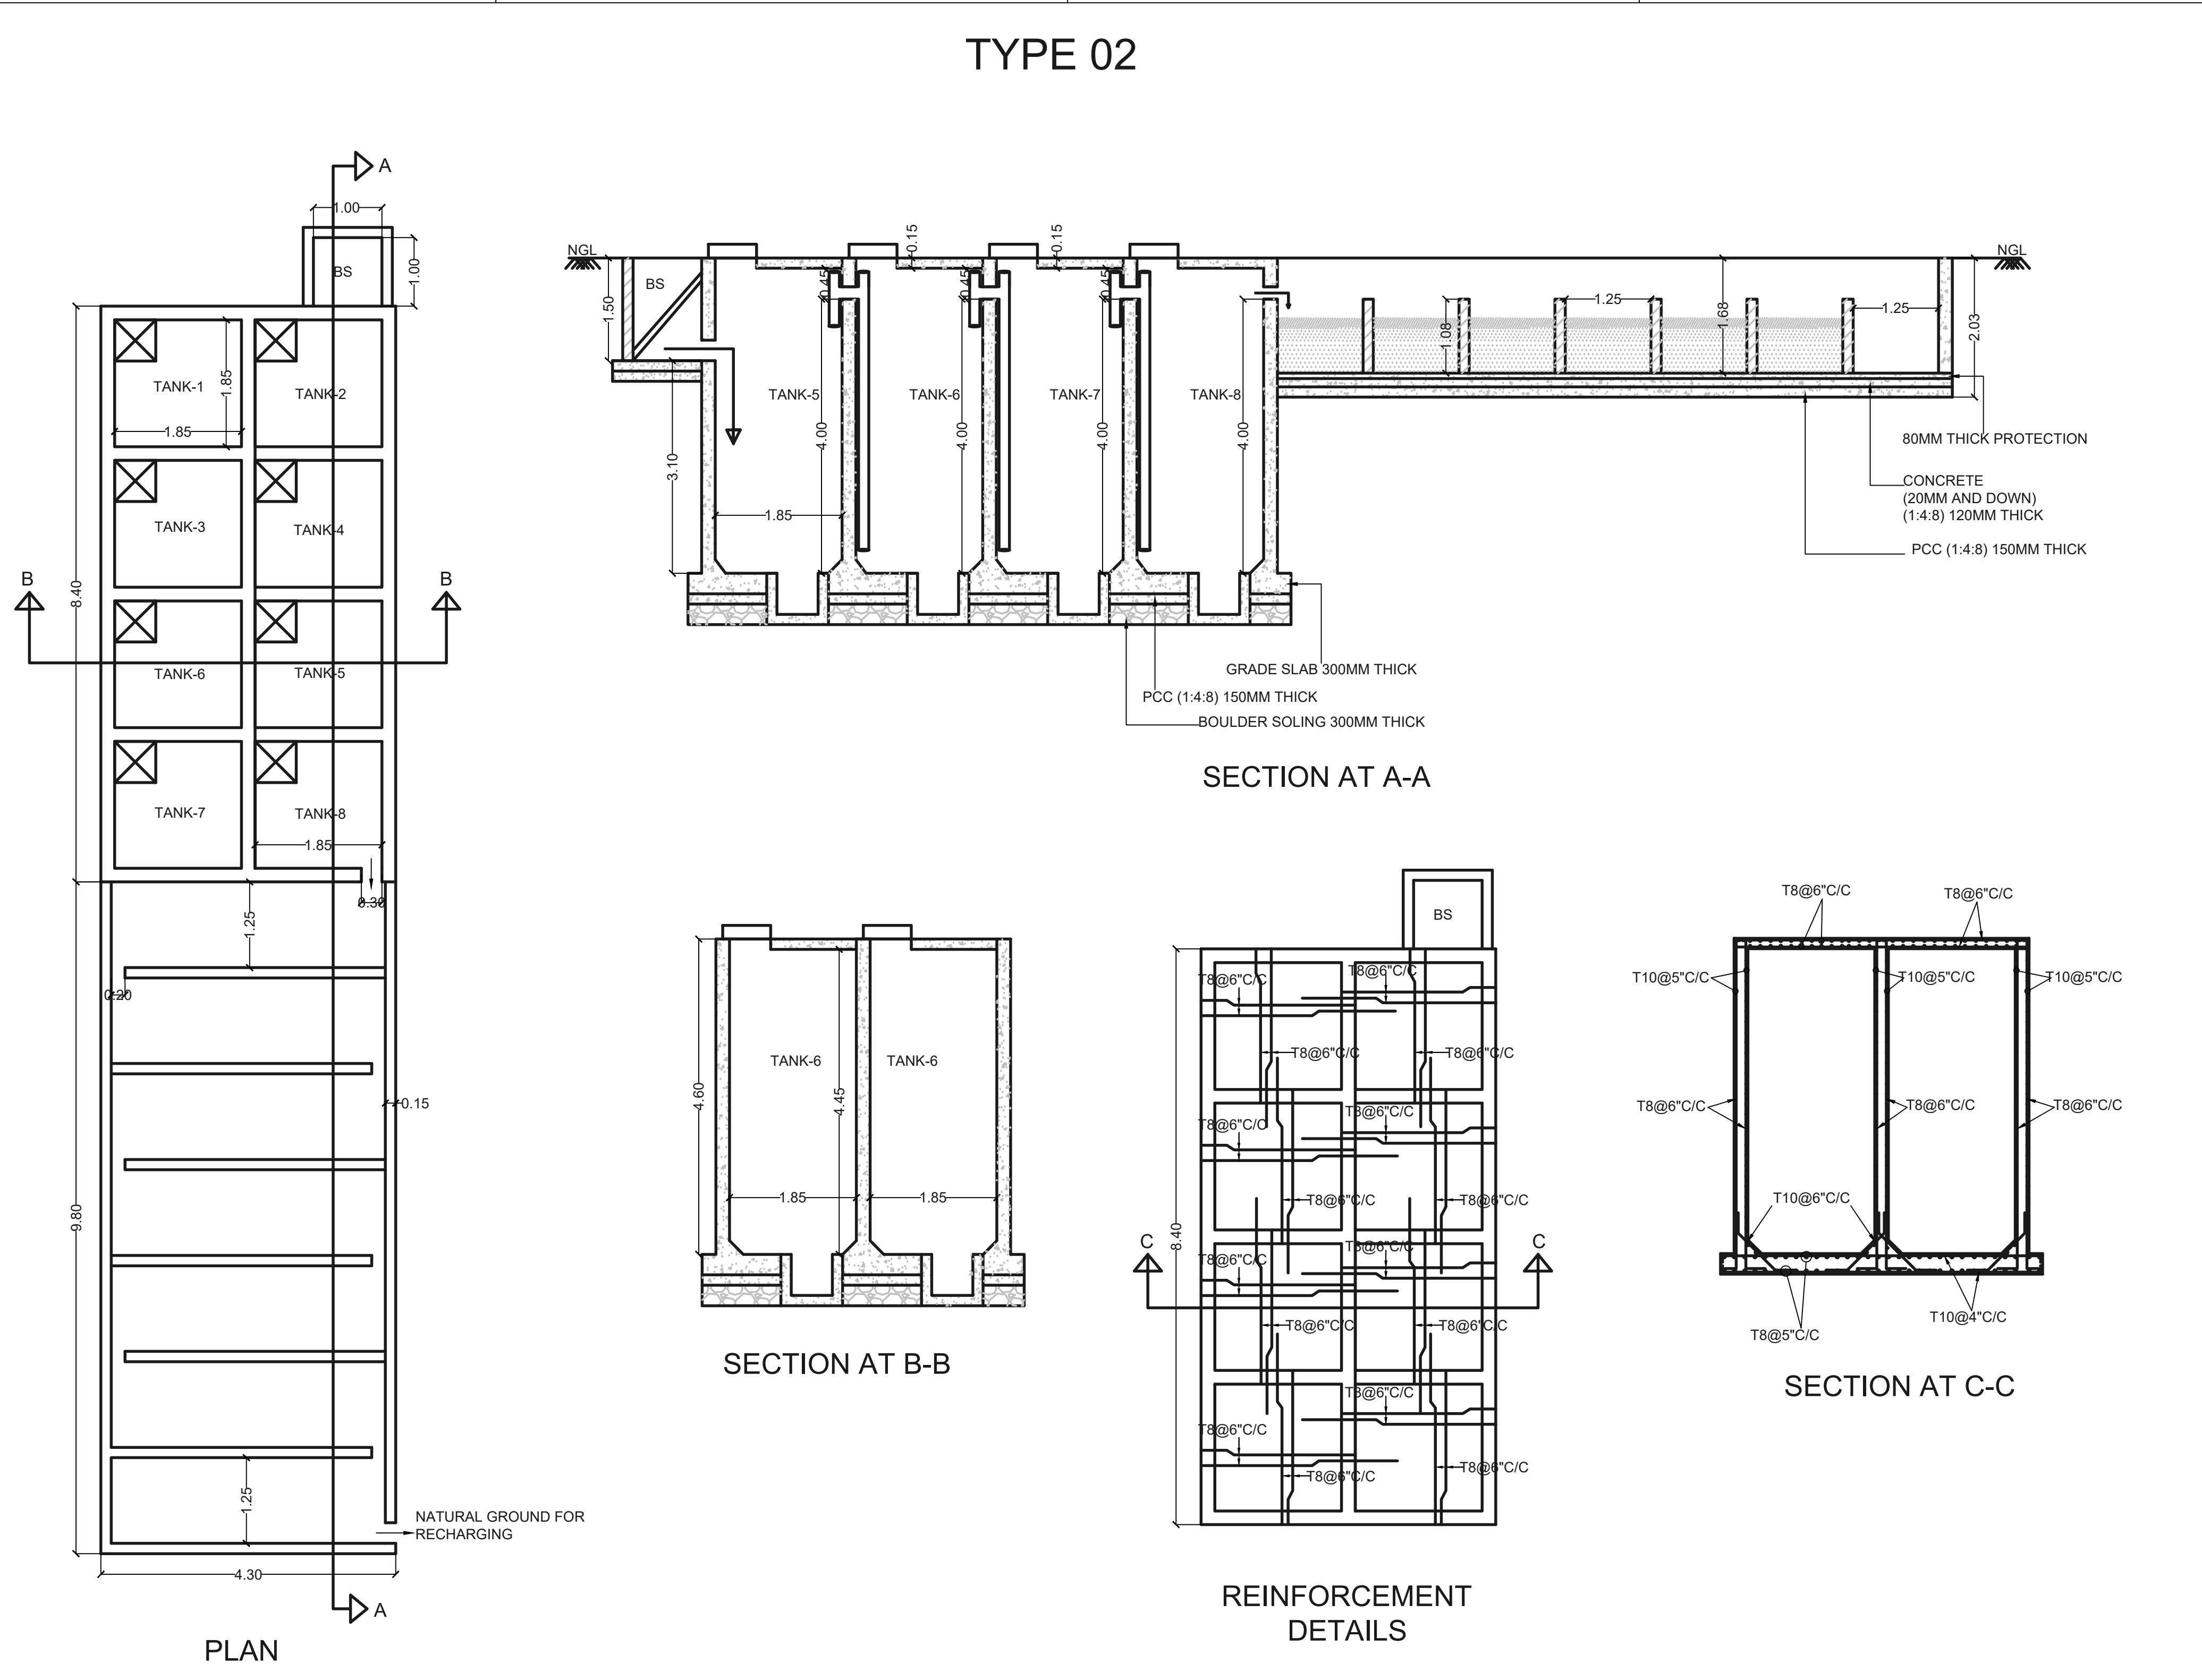


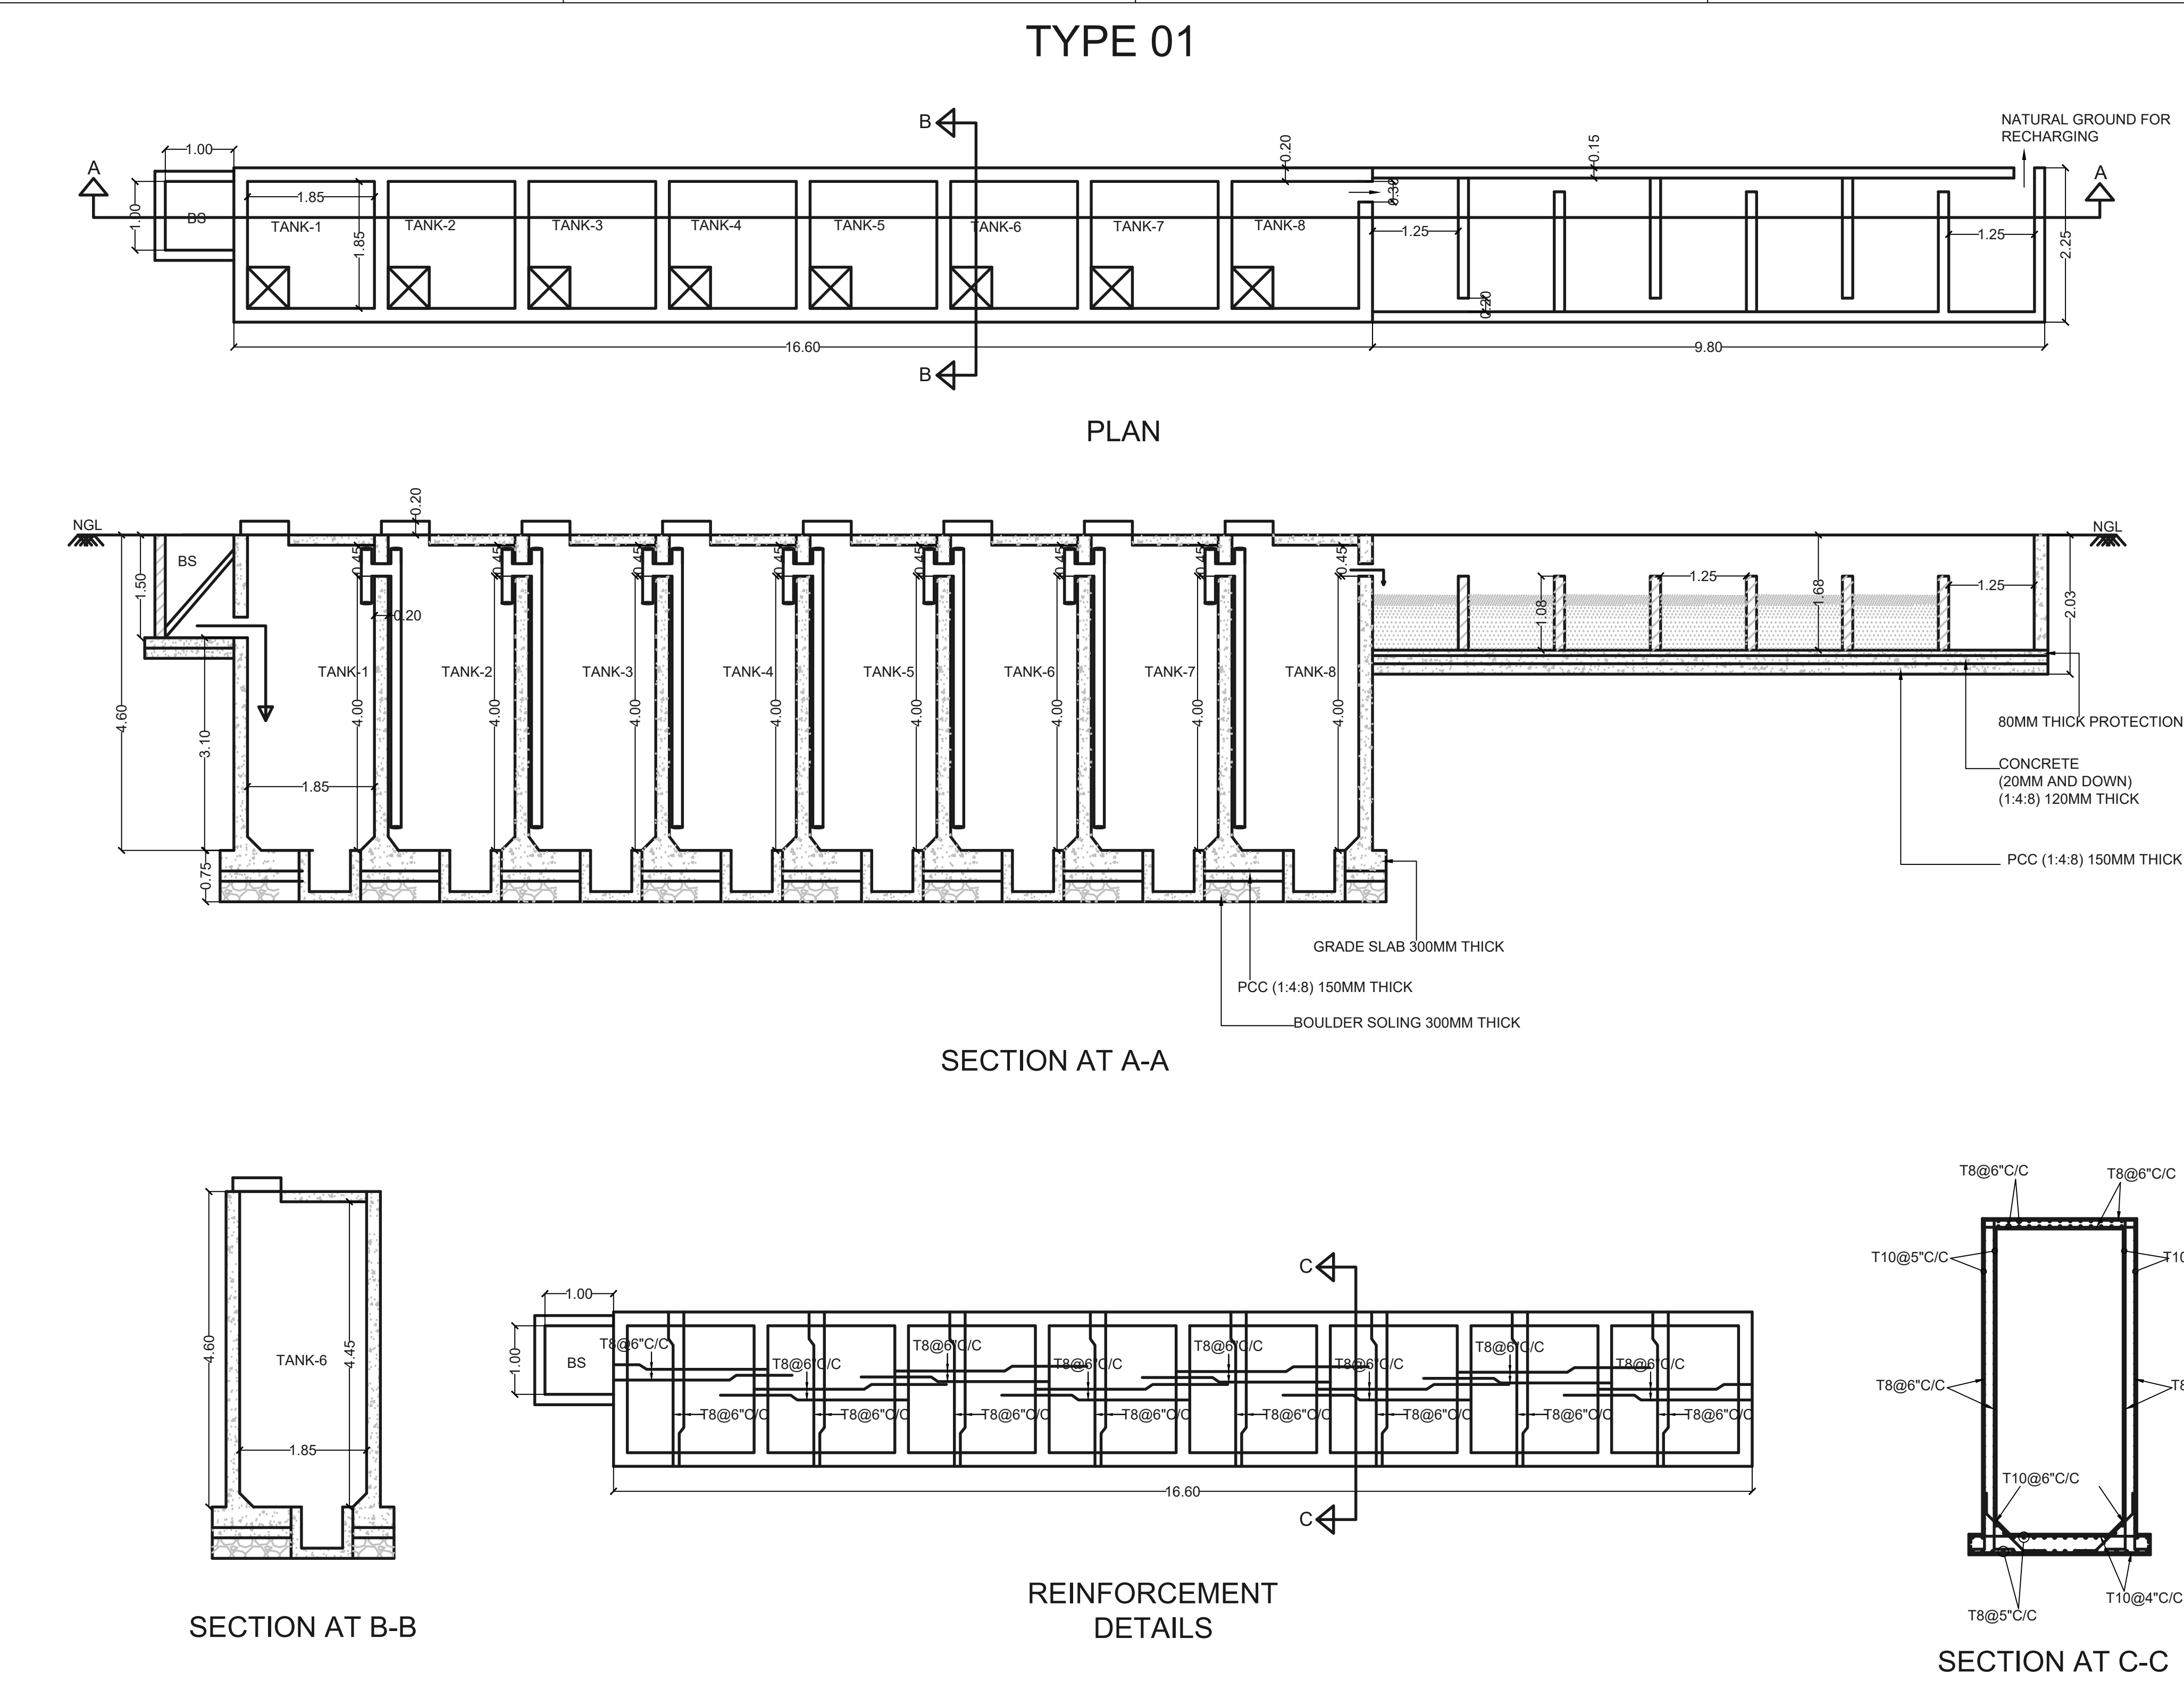

TANKS	SIZE IN METER			
SL/No	L	B	D	QTY/CUM
1	1.85	1.85	4.00	13.69
2	1.85	1.85	4.00	13.69
3	1.85	1.85	4.00	13.69
4	1.85	1.85	4.00	13.69
5	1.85	1.85	4.00	13.69
6	1.85	1.85	4.00	13.69
7	1.85	1.85	4.00	13.69
8	1.85	1.85	4.00	13.69
BS	1.00	1.00	1.50	1.50

- NOTE
1. STP DRAWING
 2. STP TYPE : NATURAL ENDOGENOUS BIO REACTOR
 3. TREATMENT METHOD : BIO CHEMICAL OXIDATION
 4. STP CAPACITY : 30 KLD
 5. PHYTORED METHODS
 6. FOR 46 HOUSES ONLY
 7. GRADE OF CONCRETE M30.
 8. GRADE OF STEEL Fe550.
 7. DEVELOPMENT/LAP LENGTHS FOR M30 GRADE CONCRETE = 50XØ OF BAR
 8. CLEAR COVER FOR SLAB 20mm.

PROJECT :		
PROPOSED STP (30 KLD)		
DWG TITLE : TANK DETAILS		
DRG NO : SD-01		
SCALE : NTS		
REV. NO	DATE	DESCRIPTION
R0	17.06.2024	
PRITHVI ECO SCIENCE PRIVATE LTD.		
MYSURU Ph no:9845201959,		
web : www.homestp.com /		
www.prithvieco.com		